


## PRIOR TO CONNECTION

### NOTE:

1. PRIOR TO FINAL APPROVAL FOR PERMANENT CONNECTION FROM KCWA, CONTRACTOR SHALL PERFORM. PRESSURE TESTING AND CHLORINATION.
2. SLEEVE FOR CLOSURE TO BE SWABBED WITH CHLORINE SOLUTION.

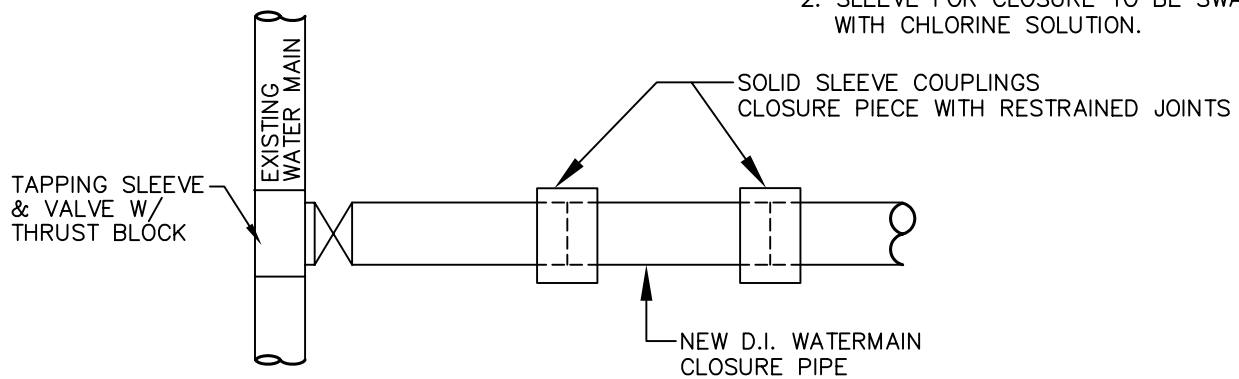

## CONNECTION

**KCWA**  
"proudly serving"

KENT COUNTY WATER AUTHORITY  
**CONNECTION OF NEW WATER MAIN  
TO EXISTING WATER MAIN**

NOT TO SCALE

DATE: 09/2006